


# CONNECTION DIAGRAMS FOR A HOT WATER PRIORITY SYSTEM FEATURING HS3D 3 PORT DIVERTER VALVE



**If a room thermostat is not being used then link terminals 4 and 7 on WB12.  
 N.B. Set switch No. 2 on the back of the FP715/CP715 to the 'gravity' position.**

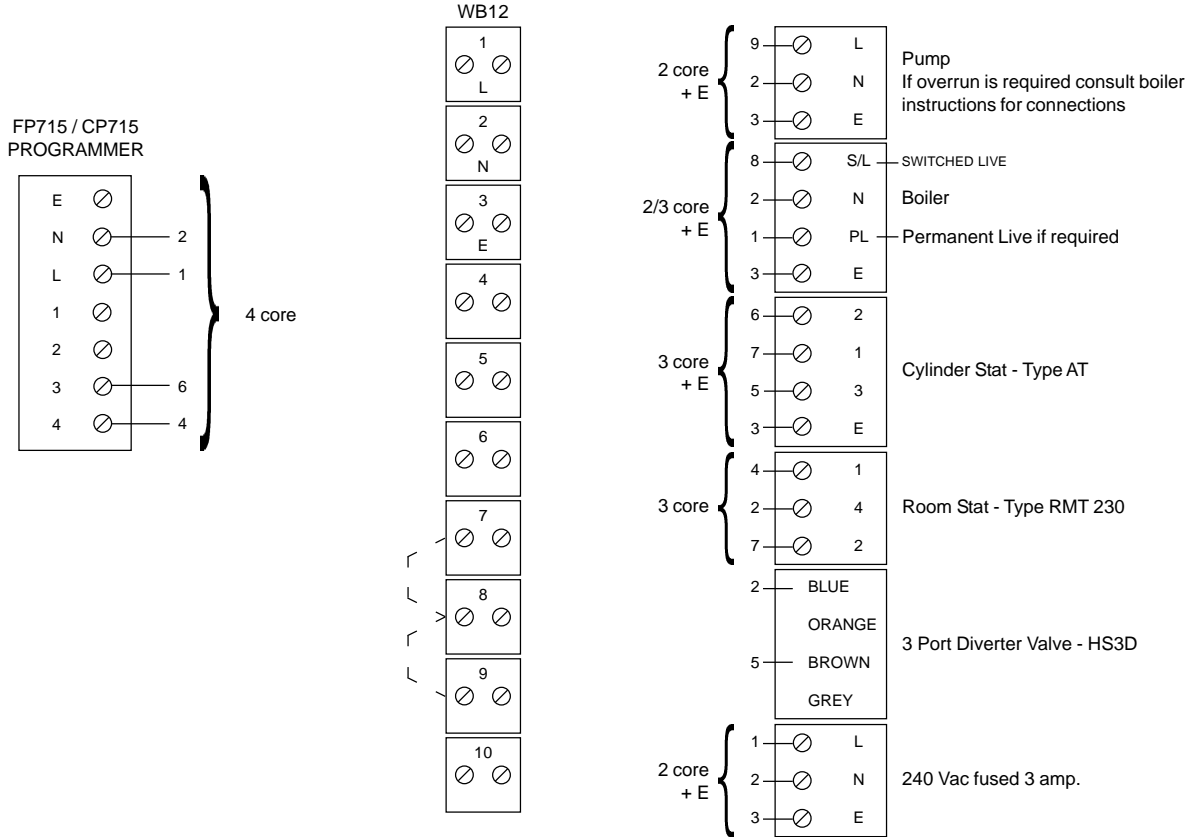

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without consequential changes being necessary in specifications already agreed.

## Danfoss Randall Ltd

Amphill Road,  
 Bedford, MK42 9ER  
 Tel: 01234 364621 Fax: 01234 219705  
 email: danfosrandall@danfoss.com  
 Website: www.danfoss-randall.co.uk

