

## Non-invasive flow measurement of cryogenic liquids

FLUXUS Cryo extends the application range of the ultrasonic clamp-on flow measurement with WaveInjector Cryo to cryogenic temperatures up to -200 °C.

The patented mounting fixture thermally separates the ultrasonic transducers from cold pipes and at the same time ensures good acoustic contact. Therefore, FLEXIM's standard transducers are suitable for long-term operation even at extremely cold temperatures.

### Features

- Non-invasive measurement without contact to the fluid
- Fluid temperature range: -200...+80 °C
- Transducers and mounting fixture can be fully integrated into the insulation
- Bidirectional measurement
- Paired and factory-calibrated transducers: no zeroizing necessary, excellent zero-point stability
- High repeatability of measurement results
- Highly reliable: maintenance-free, no moving or vibrating parts, dual-beam redundant measurement
- Operationally safe: no gaskets, no leakage points
- No pipework necessary for installation

### Applications

Flow measurement of:

- LNG
- Liquid ethane
- Liquid nitrogen
- Liquid oxygen
- Other cryogenic fluids



F721



F801




F809

Transmitters FLUXUS Cryo




WaveInjector Cryo

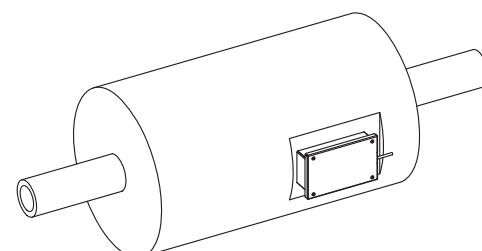

WaveInjector Cryo integrated in insulation

<b>Typical measurement setup</b>	3
<b>Transmitter F721</b>	4
Technical data	4
Dimensions	7
2" pipe mounting kit	8
Terminal assignment	9
<b>Transmitter F801</b>	10
Technical data	10
Dimensions	12
Wall and 2" pipe mounting kit	12
Terminal assignment	13
<b>Transmitter F809</b>	15
Technical data	15
Dimensions	17
Wall and 2" pipe mounting kit	17
Terminal assignment	18
<b>Transducers</b>	19
Transducer selection	19
Installation recommendation	19
Technical data	20
<b>Transducer mounting fixture</b>	22
<b>Coupling materials for transducers</b>	23
<b>Connection systems</b>	24
<b>Junction box</b>	26
Technical data	26
Dimensions	27
2" pipe mounting kit	27
<b>Transducer heating system (optional)</b>	28
Continous operation	28
Cycle operation	28
Technical data	28
<b>Insulation</b>	29

## Typical measurement setup

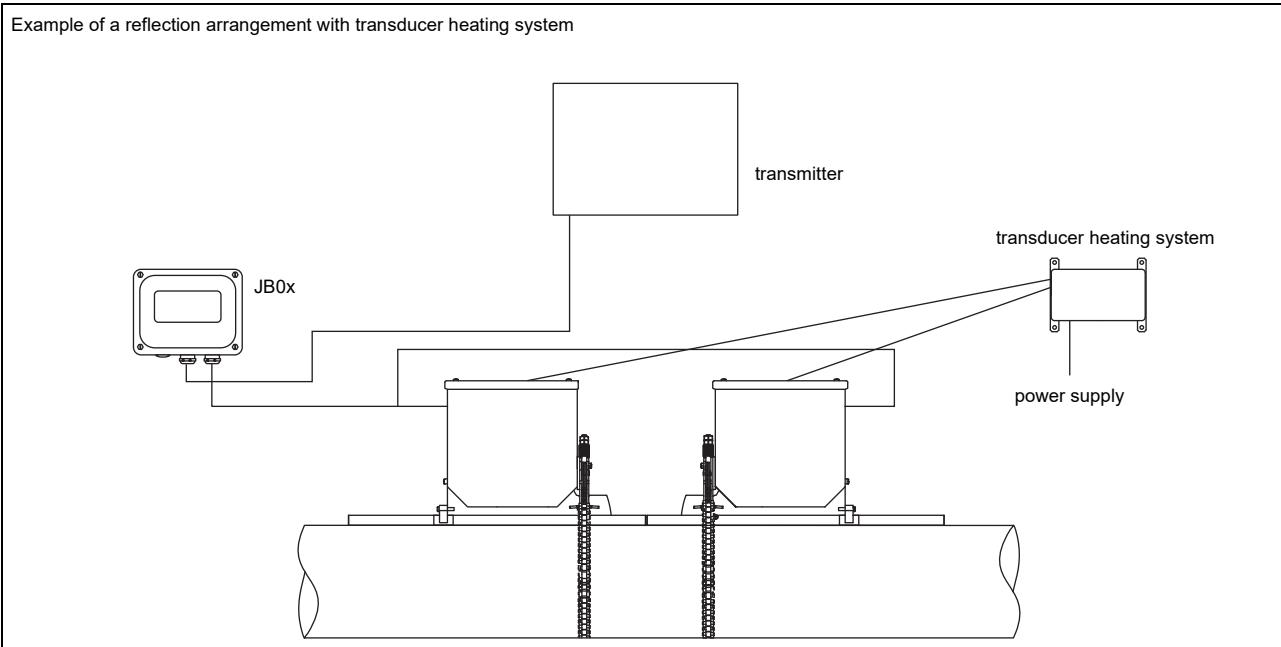

## Transmitter F721

### Technical data

	FLUXUS F721**-NN0*A	FLUXUS F721**-NN0*S	FLUXUS F721**-A20*S
			
design	standard field device nonEx	field device with stainless steel housing nonEx	field device with stainless steel housing zone 2
measurement principle	transit time difference correlation principle, automatic NoiseTrek selection for measurements with high gaseous or solid content		
flow velocity	m/s 0.01...25		
repeatability	0.15 % of reading ±0.005 m/s		
fluid	all acoustically conductive liquids with < 10 % gaseous or solid content in volume (transit time difference principle)		
temperature compensation	corresponding to the recommendations in ANSI/ASME MFC-5.1-2011		
<b>measurement uncertainty (volumetric flow rate)</b>			
measurement uncertainty of measuring system <sup>1</sup>	±0.3 % of reading ±0.005 m/s		
measurement uncertainty at the measuring point <sup>2</sup>	±1 % of reading ±0.005 m/s		
<b>transmitter</b>			
power supply	• 100...230 V/50...60 Hz or • 20...32 V DC or • 11...16 V DC		
power consumption	W < 15		
number of measuring channels	1, optional: 2		
damping	s 0...100 (adjustable)		
measuring cycle	Hz 100...1000 (1 channel)		
response time	s 1 (1 channel), option: 0.02		
housing material	aluminum, powder coated	stainless steel 316L (1.4404)	
degree of protection	IP66	IP66	IP66
dimensions	mm see dimensional drawing		
weight	kg 5.4	5.1	
fixation	wall mounting, optional: 2" pipe mounting		
ambient temperature	°C -40...+60 (< -20 °C without operation of the display)		
display	128 x 64 dots, backlight		
menu language	English, German, French, Spanish, Dutch, Russian, Polish, Turkish, Italian		
<b>explosion protection</b>			
• ATEX/IECEx			
marking	-	-	CE 0637 Ex II3G II2D Ex nA nC ic IIC T4 Gc Ex tb IIIC T120 °C Db Ta -40...+60 °C
certification ATEX	-	-	IIBExU11ATEX1015
certification IECEx	-	-	IECEx IBE 11.0008
<b>measuring functions</b>			
physical quantities	volumetric flow rate, mass flow rate, flow velocity, heat flow (if temperature inputs are installed)		
totalizer	volume, mass, optional: heat quantity		
calculation functions	average, difference, sum (2 measuring channels necessary)		
diagnostic functions	sound speed, signal amplitude, SNR, SCNR, standard deviation of amplitudes and transit times		

<sup>1</sup> with aperture calibration of the transducers

<sup>2</sup> for transit time difference principle and reference conditions

<sup>3</sup> outside of explosive atmosphere (housing cover open)

<sup>4</sup> with inputs and including parametrization of the transmitter

		FLUXUS F721**-NN0*A	FLUXUS F721**-NN0*S	FLUXUS F721**-A20*S
<b>communication interfaces</b>				
service interfaces		measured value transmission, parametrization of the transmitter: • USB <sup>3</sup> • LAN <sup>3</sup>		
process interfaces		max. 1 option: • RS485 (ASCII sender) • Modbus RTU <sup>4</sup> • BACnet MS/TP • M-Bus • HART <sup>4</sup> • Profibus PA <sup>4</sup> • FF H1 <sup>4</sup> • Modbus TCP <sup>4</sup> • BACnet IP	max. 1 option: • RS485 (ASCII sender) • Modbus RTU <sup>4</sup> • BACnet MS/TP • M-Bus • HART <sup>4</sup> • Profibus PA <sup>4</sup> • FF H1 <sup>4</sup> • Modbus TCP <sup>4</sup> • BACnet IP	max. 1 option: • RS485 (ASCII sender) • Modbus RTU <sup>4</sup> • BACnet MS/TP • HART <sup>4</sup> • Profibus PA <sup>4</sup> • FF H1 <sup>4</sup> • Modbus TCP <sup>4</sup> • BACnet IP
<b>accessories</b>				
serial data kit		USB cable		
software		• FluxDiagReader: download of measured values and parameters, graphical presentation • FluxDiag (optional): download of measurement data, graphical presentation, report generation, parametrization of the transmitter		
<b>data logger</b>				
loggable values		all physical quantities, totalized values and diagnostic values		
capacity		max. 800 000 measured values		
<b>outputs</b>				
		The outputs are galvanically isolated from the transmitter.		
number		on request		
<b>• switchable current output</b>				
range	mA	4...20 (3.2...22)		
accuracy		0.04 % of reading ±3 µA		
active output		R <sub>ext</sub> < 350 Ω		
passive output		U <sub>ext</sub> = 8...30 V, depending on R <sub>ext</sub> (R <sub>ext</sub> < 1 kΩ at 30 V)		
<b>• HART</b>				
range	mA	4...20		
accuracy		0.1 % of reading ±15 µA		
active output		U <sub>int</sub> = 24 V, R <sub>ext</sub> < 500 Ω		
passive output		U <sub>ext</sub> = 10...24 V DC, depending on R <sub>ext</sub> (R <sub>ext</sub> < 1 kΩ at 24 V)		
<b>• voltage output</b>				
range	V	0...1 or 0...10		
accuracy		0...1 V: 0.1 % of reading ±1 mV 0...10 V: 0.1 % of reading ±10 mV		
internal resistance		R <sub>int</sub> = 500 Ω		
<b>• frequency output</b>				
range	kHz	0...5		
optorelay		24 V/4 mA, R <sub>int</sub> = 66.5 Ω		
<b>• binary output</b>				
optorelay		26 V/100 mA		
Reed relay		48 V/100 mA, R <sub>int</sub> = 22 Ω		
binary output as alarm output				
• functions		limit, change of flow direction or error		
binary output as pulse output				
• functions		mainly for totalizing		
• pulse value	units	0.01...1000		
• pulse width	ms	optorelay: 1...1000 Reed relay: 80...1000		


<sup>1</sup> with aperture calibration of the transducers<sup>2</sup> for transit time difference principle and reference conditions<sup>3</sup> outside of explosive atmosphere (housing cover open)<sup>4</sup> with inputs and including parametrization of the transmitter

	FLUXUS F721**-NN0*A	FLUXUS F721**-NN0*S	FLUXUS F721**-A20*S		
<b>inputs</b>					
number	The inputs are galvanically isolated from the transmitter. max. 4, on request				
<b>• temperature input</b>					
type	Pt100/Pt1000				
connection	4-wire				
range	°C	-150...+560			
resolution	K	0.01			
accuracy	±0.01 % of reading ±0.03 K				
<b>• current input</b>					
accuracy	0.1 % of reading ±10 µA				
active input	U <sub>int</sub> = 24 V, R <sub>int</sub> = 50 Ω, P <sub>int</sub> < 0.5 W, not short-circuit proof				
• range	mA	0...20			
passive input	R <sub>int</sub> = 50 Ω, P <sub>int</sub> < 0.3 W				
• range	mA	-20...+20			
<b>• voltage input</b>					
range	V	0...1			
accuracy	0.1 % of reading ±1 mV				
internal resistance	R <sub>int</sub> = 1 MΩ				
<b>• binary input</b>					
switching signal	5...30 V, 1 mA				
functions	<ul style="list-style-type: none"> <li>• resetting the measured values</li> <li>• resetting the totalizers</li> <li>• stopping the totalizers</li> <li>• activation of the measuring mode for highly dynamic flows</li> </ul>				


<sup>1</sup> with aperture calibration of the transducers<sup>2</sup> for transit time difference principle and reference conditions<sup>3</sup> outside of explosive atmosphere (housing cover open)<sup>4</sup> with inputs and including parametrization of the transmitter

## Dimensions

\*721\*\*-\*\*\*\*A

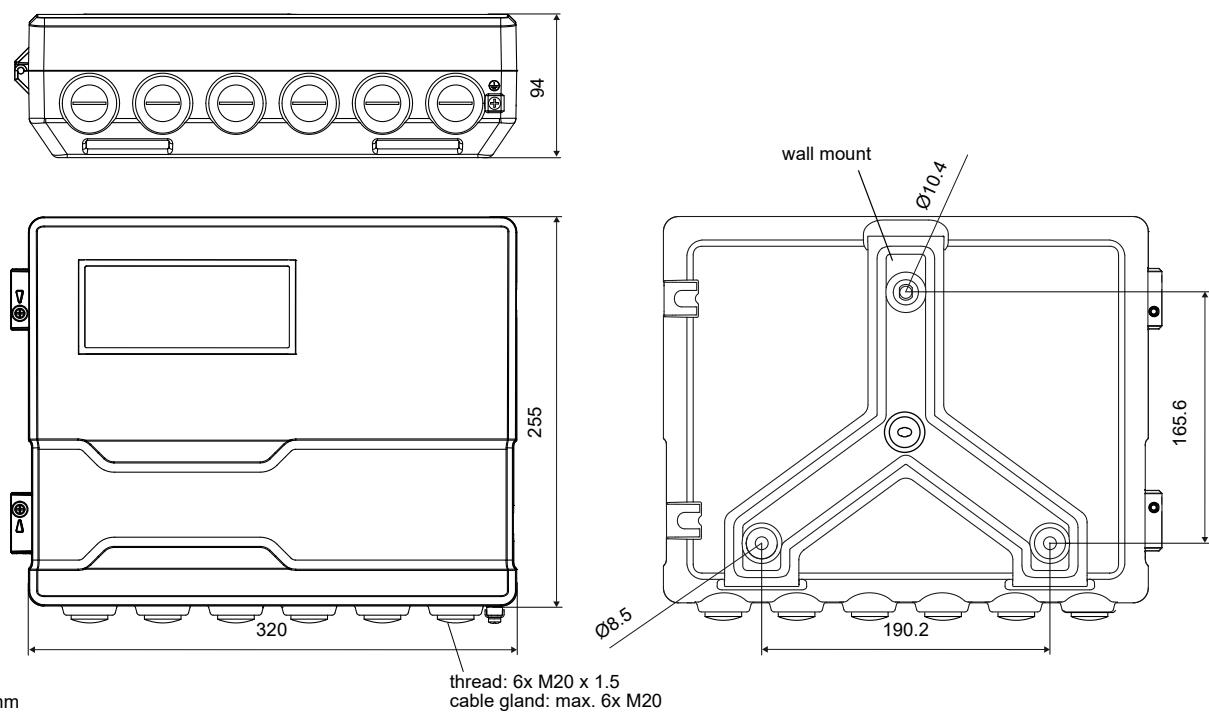


\*721\*\*-\*\*\*\*S

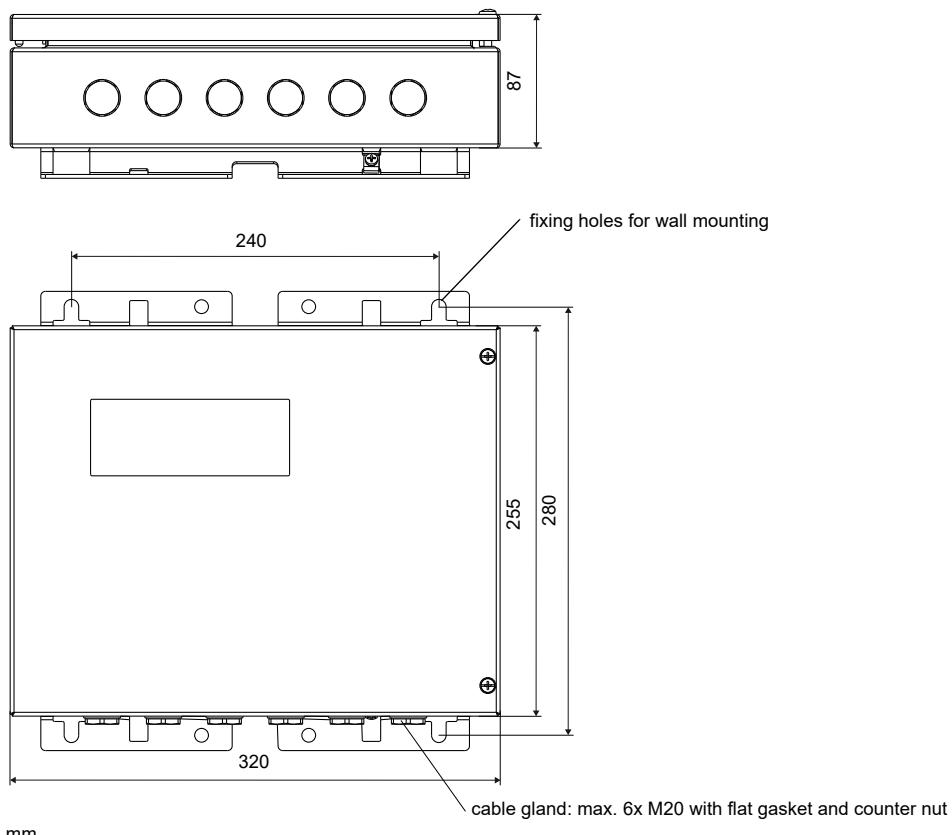


## 2" pipe mounting kit


\*721\*\*-\*\*\*\*A

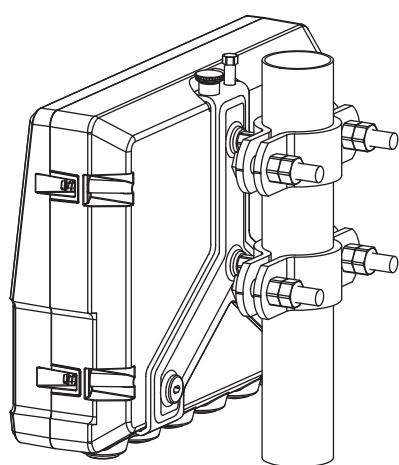

\*721\*\*-\*\*\*\*S

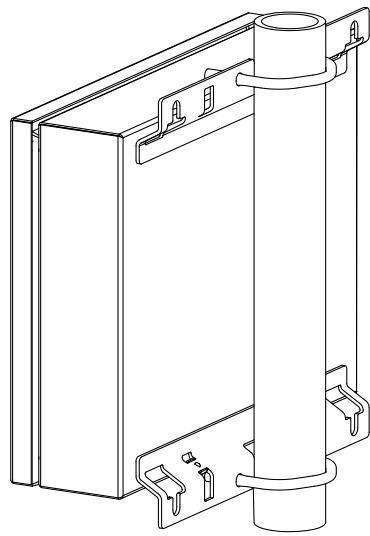

## Terminal assignment

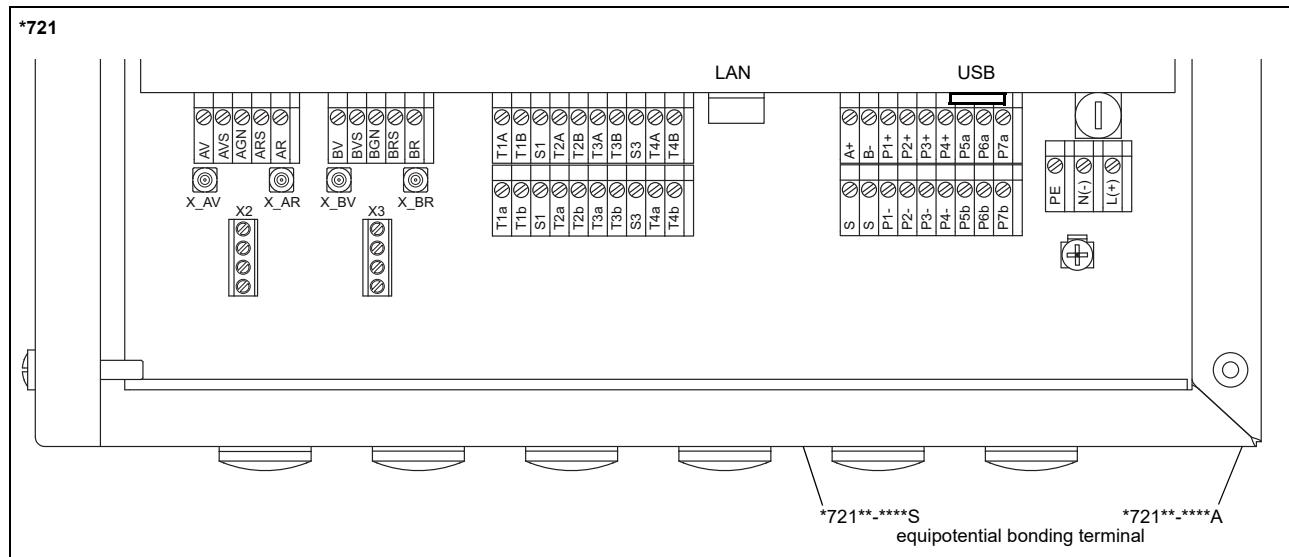

power supply <sup>1</sup>								
terminal		connection (AC)		connection (DC)				
PE		earth			earth			
N(-)		neutral			-			
L(+)		phase			+			
transducers								
transducer cable (transducers ****8*), extension cable				transducer cable (transducers ****52)				
measuring channel A		measuring channel B		measuring chan-	measuring chan-			
terminal	connection	terminal	connection	nel A	nel B			
AV	signal	BV	signal	↑	X_AV	X_BV		
AVS	shield	BVS	shield					
ARS	shield	BRS	shield		X_AR	X_BR		
AR	signal	BR	signal					
outputs <sup>1, 2</sup>								
terminal	connection		terminal	connection		communication interface		
P1+...P4+	current output, voltage output, frequency output, binary output (Reed relay), HART (P1)		A+	signal +		• RS485 <sup>1</sup> • Modbus RTU <sup>1</sup> • BACnet MS/TP <sup>1</sup> • Profibus PA <sup>1</sup> • FF H1 <sup>1</sup>		
P1-...P4-			B-	signal -				
P5a...P7a	binary output (optorelay)		S	shield		• service (FluxDiag/ FluxDiagReader) • service (FluxDiag/ FluxDiagReader) • BACnet IP • Modbus TCP		
P5b...P7b			USB	type B				
			LAN	RJ45				
analog inputs <sup>1, 2</sup>								
terminal	temperature probe		passive sensor	active sensor				
terminal	direct connection		connection with extension cable	connection	connection			
T1a...T4a	red		red	not connected		not connected		
T1A...T4A	red/blue		grey	-		+		
T1b...T4b	white/blue		blue	+		not connected		
T1B...T4B	white		white	not connected		-		
S1, S3	shield		shield	not connected		not connected		
binary inputs <sup>1, 2</sup>								
terminal								
P1+...P2+, P1-...P2-								

<sup>1</sup> cable (by customer):

- e.g. flexible leads, with insulated wire end ferrules, lead cross sectional area: 0.25...2.5 mm<sup>2</sup>
- outer diameter of the cable (\*721\*\*-\*\*\*\*S with ferrite nut): max. 7.6 mm

<sup>2</sup> The number, type and terminal assignment will be customized.

## Transmitter F801

### Technical data

	<b>FLUXUS F801**-A1</b>		<b>FLUXUS F801C24</b>
order code	F801**-A10****-*A F801**-A10****-*P	F801**-A10****-FF	F801**-A1B
			
design	explosion proof offshore device		
supported transducer frequencies	K, M, P, Q on request: G		
<b>measurement</b>			
measurement principle	transit time difference correlation principle, automatic NoiseTrek selection for measurements with high gaseous or solid content		
flow velocity	m/s	0.01...25	
repeatability		0.15 % of reading ±0.005 m/s	
fluid	all acoustically conductive liquids with < 10 % gaseous or solid content in volume (transit time difference principle)		
temperature compensation	corresponding to the recommendations in ANSI/ASME MFC-5.1-2011		
<b>measurement uncertainty (volumetric flow rate)</b>			
measurement uncertainty of measuring system <sup>1</sup>	±0.3 % of reading ±0.005 m/s		
measurement uncertainty at the measuring point <sup>2</sup>	±1 % of reading ±0.005 m/s		
<b>transmitter</b>			
power supply		• 100...230 V/50...60 Hz or • 20...32 V DC or • on request: 11...16 V DC	• 24 V DC ±10 %
power consumption	W	< 8	< 4
number of measuring channels		1, optional: 2	
damping	s	0...100 (adjustable)	
measuring cycle	Hz	100...1000 (1 channel)	
response time	s	1 (1 channel), option: 0.07	
housing material		stainless steel 316/316L (1.4401, 1.4404, 1.4432)	
degree of protection		IP66	
dimensions	mm	see dimensional drawing	
weight	kg	6.6	
fixation		wall mounting, 2" pipe mounting	
ambient temperature	°C	-20...+60	-20...+50
display		2 x 16 characters, dot matrix, backlight	
menu language		English, German, French, Dutch, Spanish	
<b>explosion protection</b>			
• ATEX/IECEx			
marking		CE 0637 Ex II2G II2D Ex db eb IIC T6 Gb Ex tb IIIC T100 °C Db Ta -20...+60 °C	CE 0637 Ex II2G Ex db eb [ib] IIC T4 Gb Ta -20...+50 °C
certification ATEX		IBExU05ATEX1078	IBExU05ATEX1078
certification IECEx		IECEx IBE 12.0020	-
intrinsic safety parameters		-	Um = 250 V AC intrinsically safe outputs: Ui = 28.2 V Pi = 0.76 W Li, Ci negligible
<b>measuring functions</b>			
physical quantities		volumetric flow rate, mass flow rate, flow velocity	
totalizer		volume, mass	
calculation functions		average, difference, sum (2 measuring channels necessary)	
diagnostic functions		sound speed, signal amplitude, SNR, SCNR, standard deviation of amplitudes and transit times	

<sup>1</sup> with aperture calibration of the transducers

<sup>2</sup> for transit time difference principle and reference conditions

<sup>3</sup> connection of the interface RS232 outside of explosive atmosphere (housing cover open)


		<b>FLUXUS F801**-A1</b>	<b>FLUXUS F801C24</b>
<b>communication interfaces</b>			
service interfaces		<ul style="list-style-type: none"> <li>• RS232<sup>3</sup></li> <li>• USB (with adapter)<sup>3</sup></li> </ul>	
process interfaces		max. 1 option: <ul style="list-style-type: none"> <li>• RS485 (ASCII sender)</li> <li>• Modbus RTU</li> <li>• HART</li> </ul>	-
<b>accessories</b>			
serial data kit		RS232 RS232 - USB	
• cable			
• adapter			
software		<ul style="list-style-type: none"> <li>• FluxDiagReader: download of measured values and parameters, graphical presentation</li> <li>• FluxDiag (optional): download of measurement data, graphical presentation, report generation</li> <li>• FluxSubstanceLoader: upload of fluid data sets</li> </ul>	
<b>data logger</b>			
loggable values		all physical quantities, totalized values and diagnostic values	
capacity		> 100 000 measured values	
<b>outputs</b>			
The outputs are galvanically isolated from the transmitter.			
number		<ul style="list-style-type: none"> <li>• current output: 1...2</li> <li>• binary output (open collector): 1...2</li> </ul> <p>or</p> <ul style="list-style-type: none"> <li>• current output: 1...2</li> <li>• binary output (open collector): 1</li> <li>• binary output (Reed relay): 1</li> </ul>	<ul style="list-style-type: none"> <li>• frequency output: 1</li> <li>• binary output (open collector): 1</li> </ul> <ul style="list-style-type: none"> <li>• current output: 1</li> <li>• binary output (open collector): 1</li> </ul>
<b>• current output</b>			
range	mA	0/4...20	-
accuracy		0.1 % of reading ±15 µA	-
active output		$R_{ext} < 500 \Omega$	-
passive output		$U_{ext} = 4...26.4 \text{ V}$ , depending on $R_{ext}$ ( $R_{ext} < 1 \text{ k}\Omega$ at 26.4 V)	-
current output in HART mode	mA	I1	-
• range		4...20	-
• active output		$U_{int} = 24 \text{ V}$	-
• passive output		$U_{ext} = 10...24 \text{ V}$	-
<b>• frequency output</b>			
range	kHz	-	0...5
open collector		-	30 V/100 mA $I_{off} = 0.8 \text{ mA}$ optional: 8.2 V DIN EN 60947-5-6 (NAMUR)
<b>• binary output</b>			
open collector		24 V/4 mA	30 V/100 mA $I_{off} = 0.8 \text{ mA}$
Reed relay		48 V/100 mA	-
binary output as alarm output			
• functions		limit, change of flow direction or error	
binary output as pulse output			
• functions		mainly for totalizing	
• pulse value	units	0.01...1000	
• pulse width	ms	1...1000	

<sup>1</sup> with aperture calibration of the transducers


<sup>2</sup> for transit time difference principle and reference conditions

<sup>3</sup> connection of the interface RS232 outside of explosive atmosphere (housing cover open)

## Dimensions

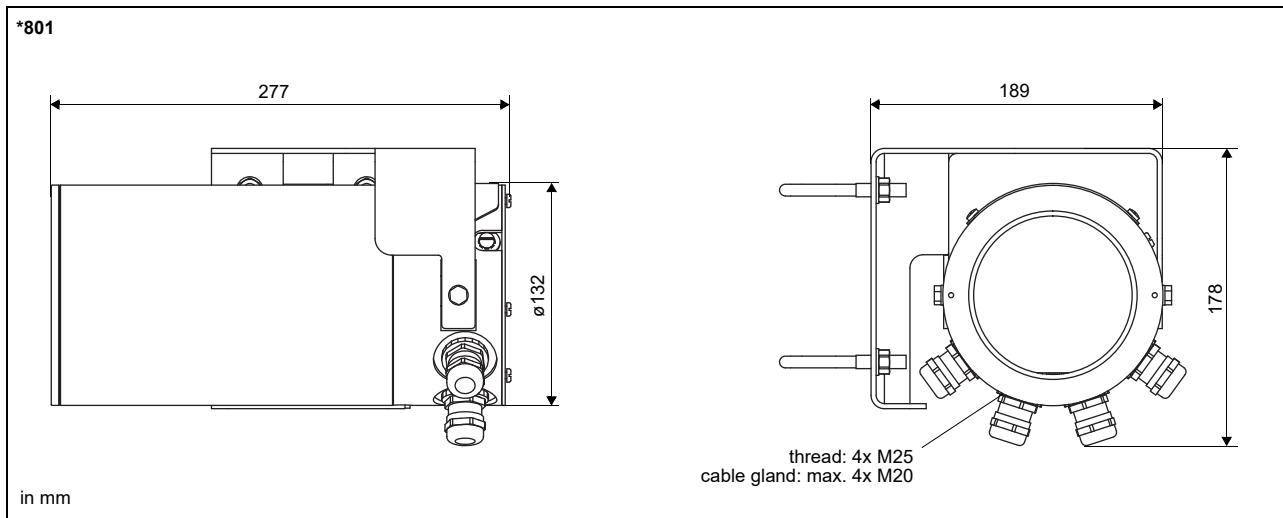


## Wall and 2" pipe mounting kit

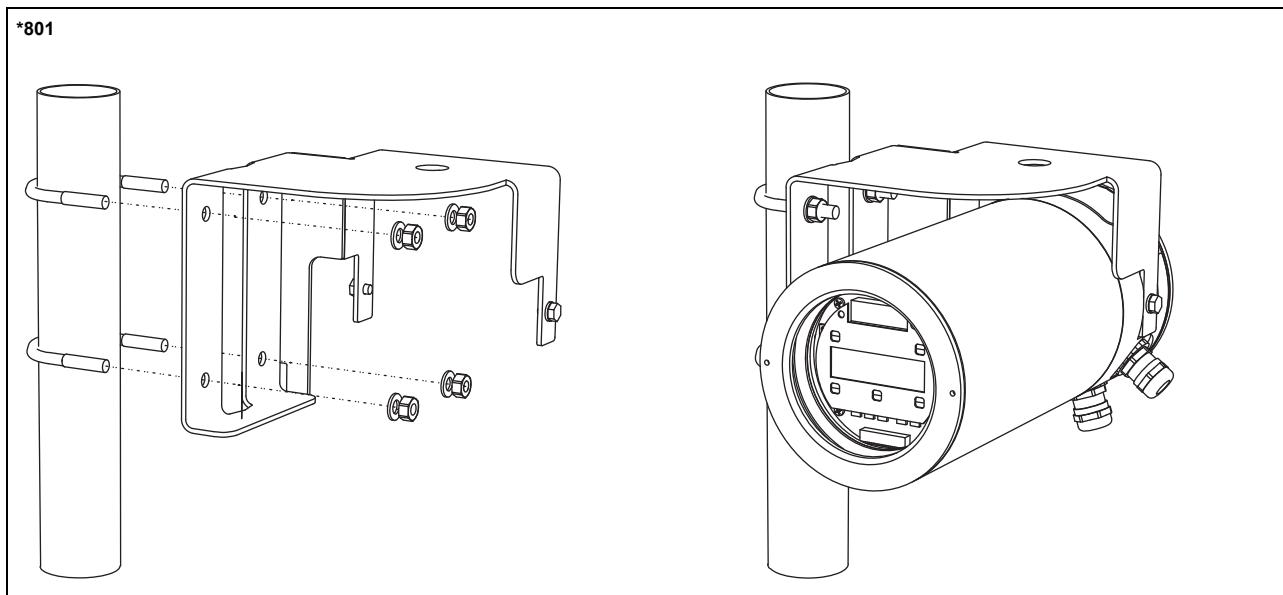

## Terminal assignment

\*801\*\*-A10\*\*\*\*-\*A, 801\*\*-A10\*\*\*\*-\*P

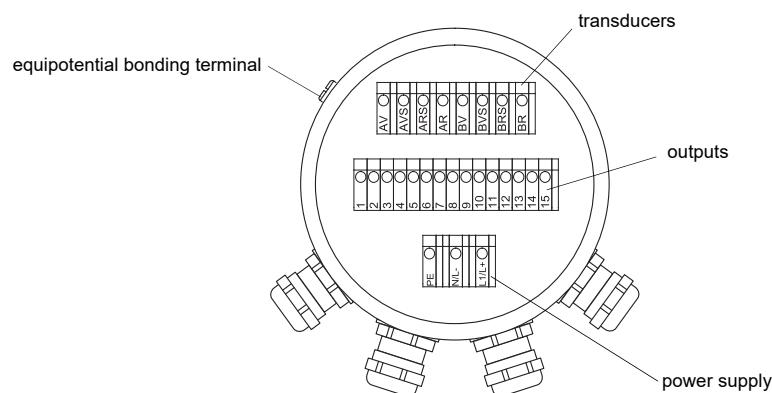

### power supply<sup>1</sup>

AC		DC	
terminal	connection	terminal	connection
L1	phase	L+	+
N	neutral	L-	-
PE	earth	PE	earth


transducers, extension cable				transducer
measuring channel A		measuring channel B		
terminal	connection	terminal	connection	
AV	signal	BV	signal	↑
AVS	internal shield	BVS	internal shield	
ARS	internal shield	BRS	internal shield	⤻
AR	signal	BR	signal	
cable gland	external shield	cable gland	external shield	↑⤻

*801**-A10****-*A		*801**-A10****-*P	
terminal	connection	terminal	connection
1(-), 2(+)	active current output I1	1(+), 2(-)	passive current output I1
3(-), 4(+)	active current output I2 (optional)	3(+), 4(-)	passive current output I2 (optional)
5(-), 6(+)	binary output B1 (open collector)		
7(-), 8(+)	binary output B2 (open collector, optional)		
9(a), 10(b)	binary output B1 (open collector, Reed relay, optional)		
11(a), 12(b)	binary output B2 (open collector, Reed relay, optional)		
13(B-), 14(A+), 15 (shield)	communication interface		

<sup>1</sup> cable (by customer): e.g. flexible leads, with insulated wire end ferrules, lead cross sectional area: 0.25...2.5 mm<sup>2</sup>

\*801C24, \*801\*\*-A10\*\*\*\*-FF

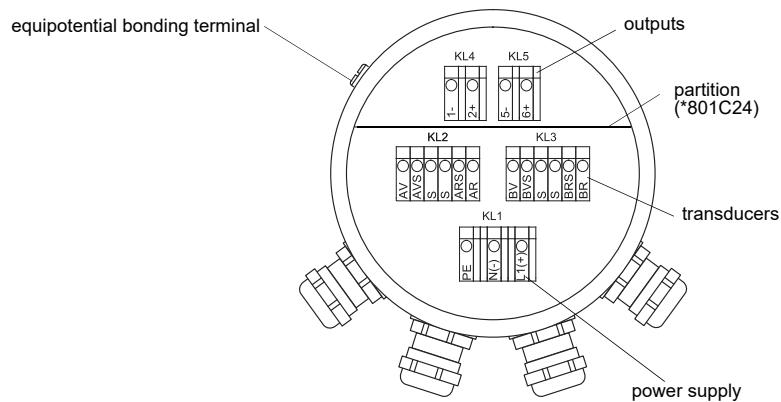

#### power supply<sup>1</sup>

AC		DC	
*801**-A10****-FF		*801C24, *801**-A10****-FF	
terminal	connection	terminal	connection
L1	phase	L+	+
N	neutral	L-	-
PE	earth	PE	earth

transducers, extension cable				
measuring channel A		measuring channel B		transducer
terminal	connection	terminal	connection	
AV	signal	BV	signal	↑
AVS	internal shield	BVS	internal shield	
ARS	internal shield	BRS	internal shield	↗
AR	signal	BR	signal	
S	not connected	S	not connected	
cable gland	external shield	cable gland	external shield	↑ ↗

outputs <sup>1</sup>		*801C24		*801**-A10****-FF	
colour of terminals	connection	connection	connection	connection	connection
terminal	connection	connection	connection	connection	connection
1(-), 2(+)	current output I1	frequency output F1			
5(-), 6(+)	binary output B1	binary output B1			

<sup>1</sup> cable (by customer): e.g. flexible leads, with insulated wire end ferrules, lead cross sectional area: 0.25...2.5 mm<sup>2</sup>

## Transmitter F809

### Technical data

	FLUXUS F809**-A1	FLUXUS F809**-A1A		
				
design	explosion proof field device 1 or 2 measuring channels zone 1	explosion proof field device 1 or 2 measuring channels zone 1 (intrinsically safe current output)		
supported transducer frequencies	K, M, P, Q on request: G	K, M, P, Q on request: G		
<b>measurement</b>				
measurement principle	transit time difference correlation principle, automatic NoiseTrek selection for measurements with high gaseous or solid content			
flow velocity	m/s 0.01...25			
repeatability	0.15 % of reading ±0.005 m/s			
fluid	all acoustically conductive liquids with < 10 % gaseous or solid content in volume (transit time difference principle)			
temperature compensation	corresponding to the recommendations in ANSI/ASME MFC-5.1-2011			
<b>measurement uncertainty (volumetric flow rate)</b>				
measurement uncertainty of measuring system <sup>1</sup>	±0.3 % of reading ±0.005 m/s			
measurement uncertainty at the measuring point <sup>2</sup>	±1 % of reading ±0.005 m/s			
<b>transmitter</b>				
power supply	• 100...230 V/50...60 Hz or • 20...32 V DC			
power consumption	W < 8			
number of measuring channels	1, optional: 2			
damping	s 0...100 (adjustable)			
measuring cycle	Hz 100...1000 (1 channel)			
response time	s 1 (1 channel), option: 0.07			
housing material	cast aluminum, special heavy-duty coating			
degree of protection	IP66			
dimensions	mm see dimensional drawing			
weight	kg 7.1			
fixation	wall mounting, 2" pipe mounting			
ambient temperature	°C -30...+60 (< -20 °C without operation of the display)			
display	2 x 16 characters, dot matrix, backlight			
menu language	English, German, French, Dutch, Spanish			
<b>explosion protection</b>				
• ATEX/IECEx				
marking	CE 0637 Ex II2G II2D Ex db eb IIC T6 Gb Ex tb IIIC T100 °C Db Ta -40...+60 °C	CE 0637 Ex II2G II2D Ex db eb ia IIC T6 Gb Ex tb ia IIIC T100 °C Db Ta -40...+60 °C		
certification ATEX	IBExU11ATEX1022 X	IBExU11ATEX1022 X		
certification IECEx	IECEx IBE 11.0006X	IECEx IBE 11.0006X		
intrinsic safety parameters	-	Um = 250 V Ui = 30 V DC Ii = 100 mA Pi = 0.75 W Ci = 3 nF Li negligible		
<b>measuring functions</b>				
physical quantities	volumetric flow rate, mass flow rate, flow velocity			
totalizer	volume, mass			
calculation functions	average, difference, sum (2 measuring channels necessary)			
diagnostic functions	sound speed, signal amplitude, SNR, SCNR, standard deviation of amplitudes and transit times			

<sup>1</sup> with aperture calibration of the transducers


<sup>2</sup> for transit time difference principle and reference conditions

<sup>3</sup> connection of the interface RS232 outside of explosive atmosphere (housing cover open)


	<b>FLUXUS F809**-A1</b>	<b>FLUXUS F809**-A1A</b>
<b>communication interfaces</b>		
service interfaces	<ul style="list-style-type: none"> <li>• RS232<sup>3</sup></li> <li>• USB (with adapter)<sup>3</sup></li> </ul>	
process interfaces	max. 1 option: <ul style="list-style-type: none"> <li>• RS485 (ASCII sender)</li> <li>• Modbus RTU</li> <li>• HART</li> </ul>	• HART
<b>accessories</b>		
serial data kit	RS232 RS232 - USB	
software	<ul style="list-style-type: none"> <li>• FluxDiagReader: download of measured values and parameters, graphical presentation</li> <li>• FluxDiag (optional): download of measurement data, graphical presentation, report generation</li> <li>• FluxSubstanceLoader: upload of fluid data sets</li> </ul>	
<b>data logger</b>		
loggable values	all physical quantities, totalized values and diagnostic values	
capacity	> 100 000 measured values	
<b>outputs</b>		
	The outputs are galvanically isolated from the transmitter.	
number	max. 4	1
<b>• current output</b>		
number	max. 2 (I1, I2)	1 (I1, intrinsic safety)
range	mA 0/4...20	4...20
accuracy	0.1 % of reading ±15 µA	0.04 % of reading ±3 µA
active output	$R_{ext} < 500 \Omega$	-
passive output	$U_{ext} = 4...26.4 \text{ V}$ , depending on $R_{ext}$ ( $R_{ext} < 1 \text{ k}\Omega$ at 26.4 V)	$U_{ext} = 7...30 \text{ V}$ , depending on $R_{ext}$ ( $R_{ext} < 1 \text{ k}\Omega$ at 30 V)
current output in HART mode	I1	I1
• range	mA 4...20	4...20
• active output	$U_{int} = 24 \text{ V}$	-
• passive output	$U_{ext} = 7...30 \text{ V DC}$	$U_{ext} = 7...30 \text{ V DC}$
<b>• frequency output</b>		
number	max. 1	-
range	kHz 0...5	-
open collector	30 V/100 mA or 8.2 V DIN EN 60947-5-6 (NAMUR) or 24 V/4 mA (on request)	-
<b>• binary output</b>		
number	max. 2	-
open collector	24 V/4 mA optional: <ul style="list-style-type: none"> <li>• 30 V/100 mA or</li> <li>• 8.2 V DIN EN 60947-5-6 (NAMUR)</li> </ul>	-
Reed relay	48 V/100 mA	-
<b>binary output as alarm output</b>		
• functions	limit, change of flow direction or error	-
<b>binary output as pulse output</b>		
• functions	mainly for totalizing	-
• pulse value	units 0.01...1000	-
• pulse width	ms 1...1000	-

<sup>1</sup> with aperture calibration of the transducers<sup>2</sup> for transit time difference principle and reference conditions<sup>3</sup> connection of the interface RS232 outside of explosive atmosphere (housing cover open)


## Dimensions

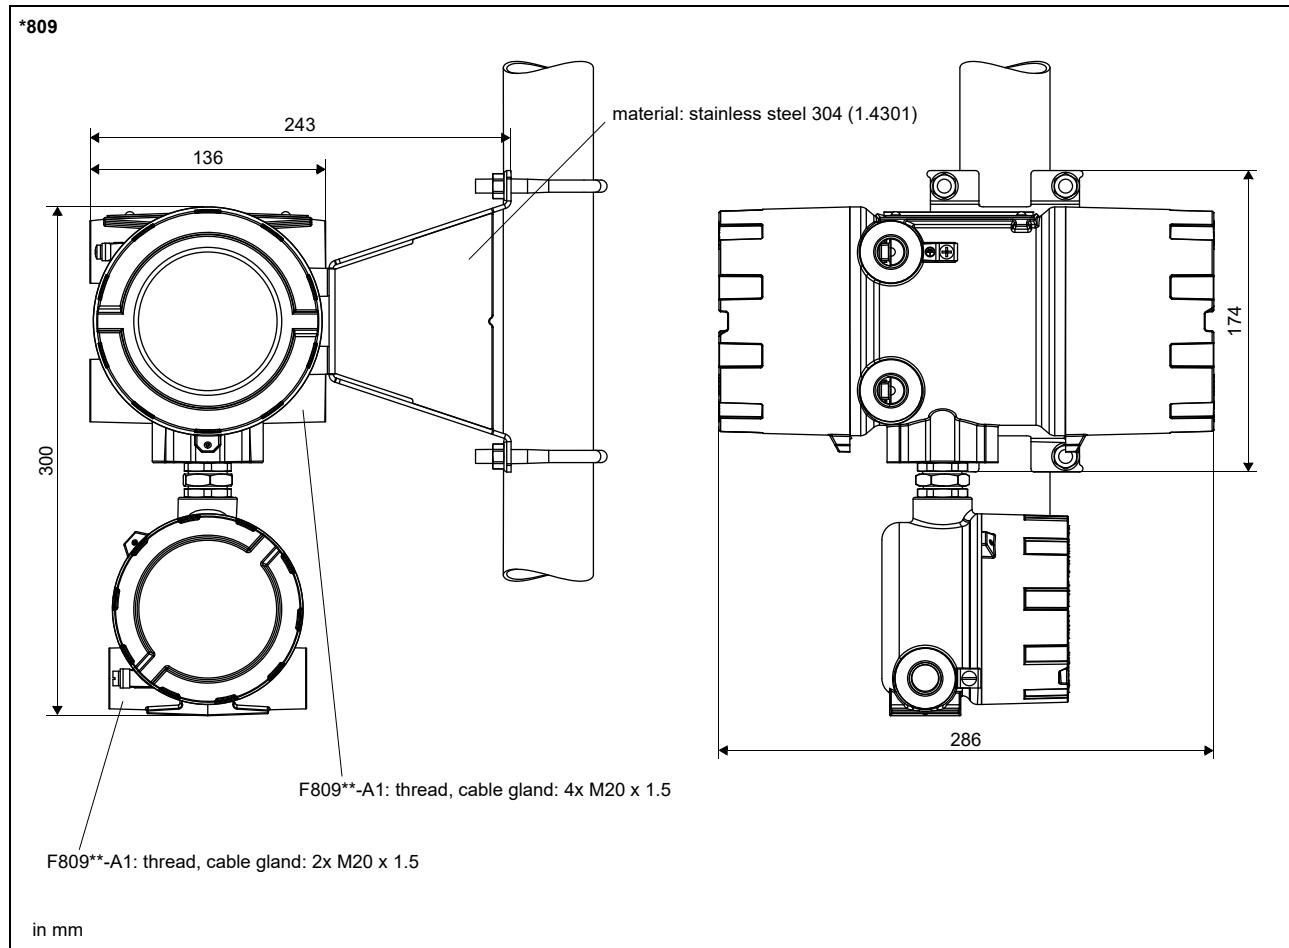

## Wall and 2" pipe mounting kit

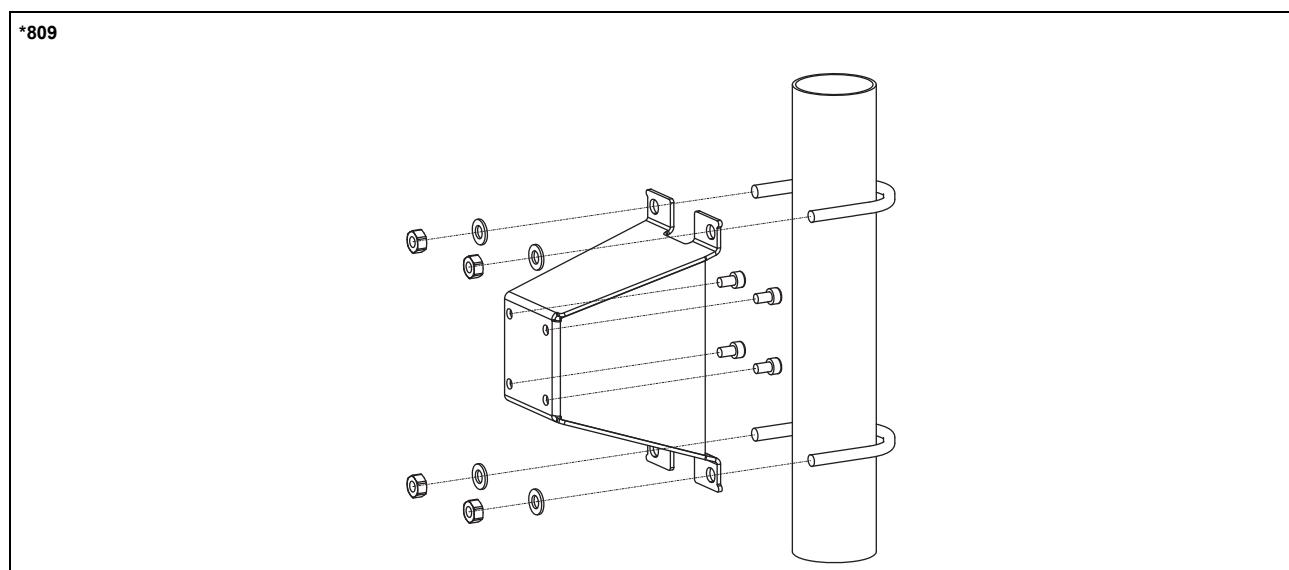

## Terminal assignment

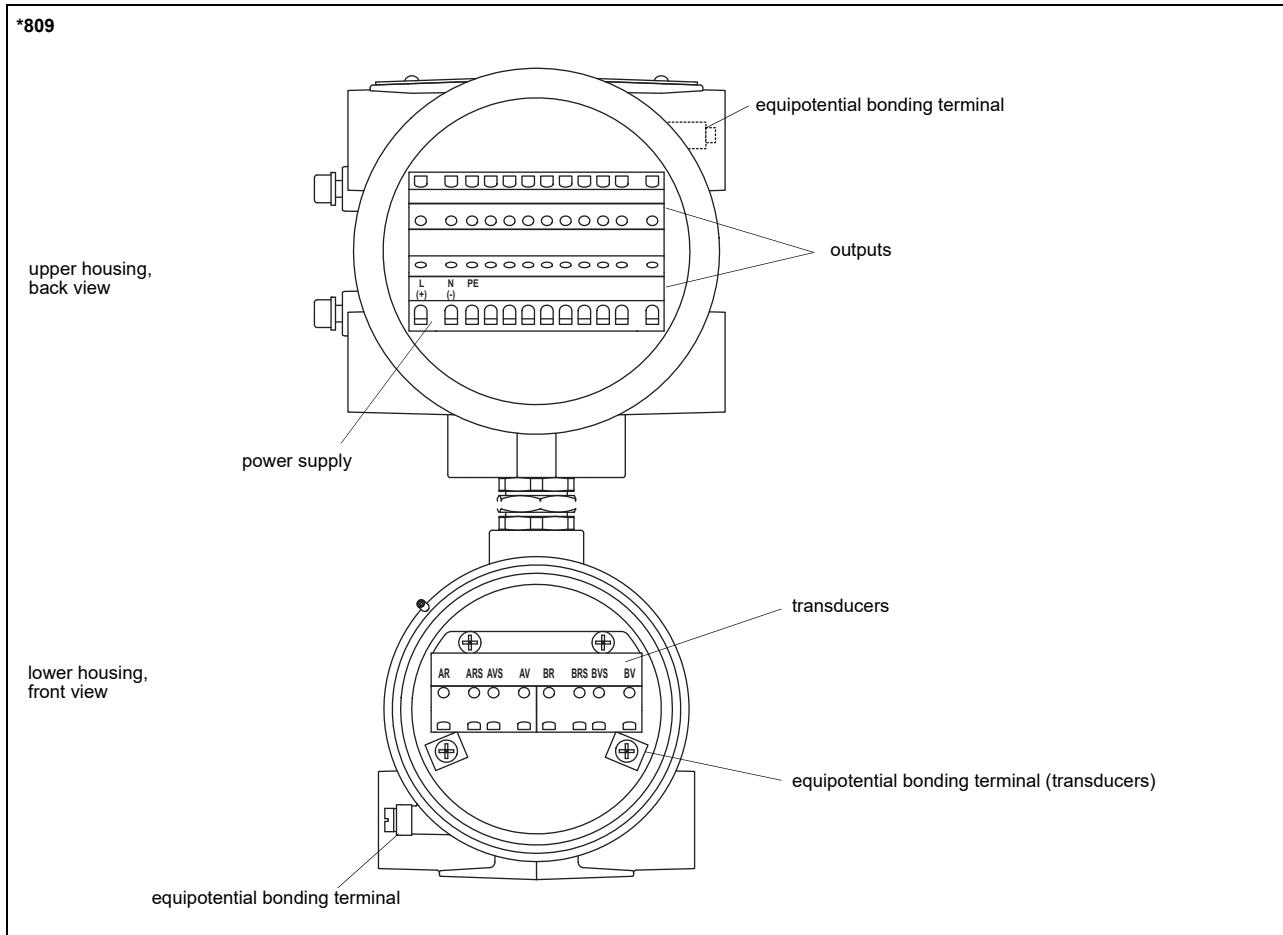

### power supply<sup>1</sup>

AC		DC	
terminal	connection	terminal	connection
L	phase	L+	+
N	neutral	N-	-
PE	earth	PE	earth

### transducers, extension cable

measuring channel A		measuring channel B		transducer
terminal	connection	terminal	connection	
AV	signal	BV	signal	↑
AVS	internal shield	BVS	internal shield	↗
ARS	internal shield	BRS	internal shield	↖
AR	signal	BR	signal	↗↖
cable gland or equipotential bonding terminal (transducers)	external shield	cable gland or equipotential bonding terminal (transducers)	external shield	↑↖

### outputs (options)<sup>1</sup>

terminal	connection
1(-), 2(+)	current output I1
3(-), 4(+)	current output I2
5(-), 6(+)	binary output B1 (open collector)
7(-), 8(+)	binary output B2 (open collector)
9(-), 10(+)	binary output B1 (Reed relay)
A+, B-, S	communication interface


<sup>1</sup> cable (by customer): e.g. flexible leads, with insulated wire end ferrules, lead cross sectional area: 0.25...2.5 mm<sup>2</sup>

## Transducers


### Transducer selection

- for LNG, others on request
- transducer mounting fixture available for outer pipe diameter 70...1000 mm  
on request: 40...70 mm, > 1000 mm

transducer order code

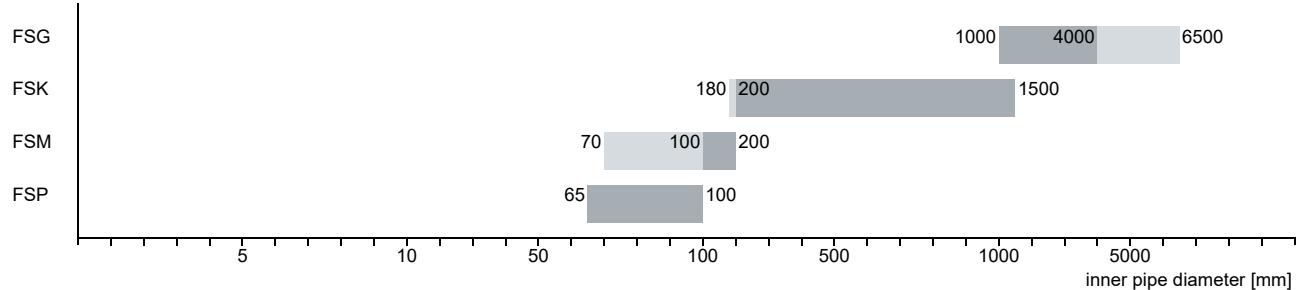

transducer order code

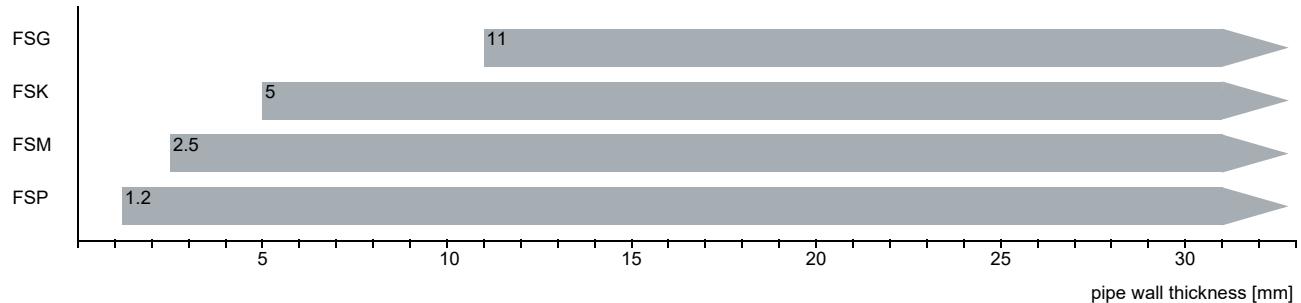

recommended

possible

### Installation recommendation

inner pipe diameter mm	measurement arrangement	number of sound paths	min. number of measuring channels
65...100	diagonal arrangement	3	1
>100...180	reflection arrangement	2	1
>180	diagonal arrangement	1	2

## Technical data


### Shear wave transducers (zone 2 - nonEx, TS)

order code	FSG-N**TS/**	FSK-N**TS/**	FSM-N**TS/**	FSP-N**TS/**
technical type	C(DL)G1N52	C(DL)K1N52	C(DL)M2N52	C(DL)P2N52
transducer frequency MHz	0.2	0.5	1	2
inner pipe diameter	see Transducer selection			
pipe wall thickness				
min.	mm	11	5	2.5
				1.2
material				
housing	PEEK with stainless steel cap 304 (1.4301), ***-****/OS: 316L (1.4404)			
contact surface	PEEK			
degree of protection	IP67			
transducer cable				
type	1699			
length	m	5		4
length (***-****/LC)	m	9		
dimensions				
length l	mm	129.5	126.5	64
width b	mm	51	51	32
height h	mm	67	67.5	40.5
dimensional drawing				
weight (without cable)	kg	0.47	0.36	0.066
pipe surface temperature <sup>1</sup>				
min.	°C	-40		
max.	°C	+130		
ambient temperature				
min.	°C	-40		
max.	°C	+130		
temperature compensation		x		
explosion protection				
• ATEX/IECEx				
order code	FSG-NA2TS/**	FSK-NA2TS/**	FSM-NA2TS/**	FSP-NA2TS/**
pipe surface temperature (Ex)				
• min.	°C	-55		
• max.	°C	gas: +190, dust: +180		
marking		CE0637 Ex II3G II2D Ex nA IIC T6...T2 Gc Ex tb IIIC TX Db		
certification ATEX	IBExU10ATEX1163 X			
certification IECEx	IECEx IBE 12.0005X			

<sup>1</sup> pipe surface temperature when using transducers with WI-CYO: min. -200 °C

The specified temperatures at the transducer contact surface are met if the transducers are installed with the correct insulation and heating.

**Shear wave transducers (zone 1, TS)**

order code	FSG-N*1TS/**	FSK-N*1TS/**	FSM-N*1TS/**	FSP-N*1TS/**
technical type	C(DL)G1N81	C(DL)K1N81	C(DL)M2N81	C(DL)P2N81
transducer frequency	MHz 0.2	0.5	1	2
inner pipe diameter	see Transducer selection			
<b>pipe wall thickness</b>				
min.	mm 11	5	2.5	1.2
<b>material</b>				
housing	PEEK with stainless steel cap 304 (1.4301), ***_*****/OS: 316L (1.4404)			
contact surface	PEEK			
degree of protection	IP65	IP66		
<b>transducer cable</b>				
type	1699			
length	m 5		4	
length (***_*****/LC)	m 9			
<b>dimensions</b>				
length l	mm 129.5	126.5	64	
width b	mm 51	51	32	
height h	mm 67	67.5	40.5	
dimensional drawing				
weight (without cable)	kg 0.47	0.36	0.066	
<b>pipe surface temperature</b>				
min.	°C -40			
max.	°C +130			
<b>ambient temperature</b>				
min.	°C -40			
max.	°C +130			
temperature compensation	x			
<b>explosion protection</b>				
• ATEX/IECEx				
order code	FSG-NA1TS/**	FSK-NA1TS/**	FSM-NA1TS/**	FSP-NA1TS/**
pipe surface temperature (Ex)				
• min.	°C -55			
• max.	°C +180			
marking	 0637  II2G  II2D Ex q IIC T6...T3 Gb Ex tb IIIC TX Db			
certification ATEX	IBExU07ATEX1168 X			
certification IECEx	IECEx IBE 08.0007X			
remark	F801, F809: on request			

<sup>1</sup> pipe surface temperature when using transducers with WI-CYO: min. -200 °C


The specified temperatures at the transducer contact surface are met if the transducers are installed with the correct insulation and heating.

## Transducer mounting fixture

### Order code

1...6	7	8	9	10	11...13	14	15	no. of character
WaveInjector	transducer	-	measurement arrangement	size	-	fixation	outer pipe diameter <sup>1</sup>	
WI-CYO	type							
	K shear wave transducers with transducer frequency G, K							
	M shear wave transducers with transducer frequency M, P							
	D reflection arrangement or diagonal arrangement							
	L large							
	C chains							
	017 70...170 mm							
	038 80...380 mm							
	056 350...560 mm							
	085 560...850 mm							
	100 600...1000 mm							
	D coupling foil -200...+80 °C							
	A automatic WI tool							
	M mechanical WI tool (pipe planer)							
	O WIT-R tool 110 V							
	R WIT-R tool 230 V							
	N without tool							
	B cryo insulation boxes for measuring channel (without transducer heating system)							



<sup>1</sup> outer pipe diameter > 1000 mm on request

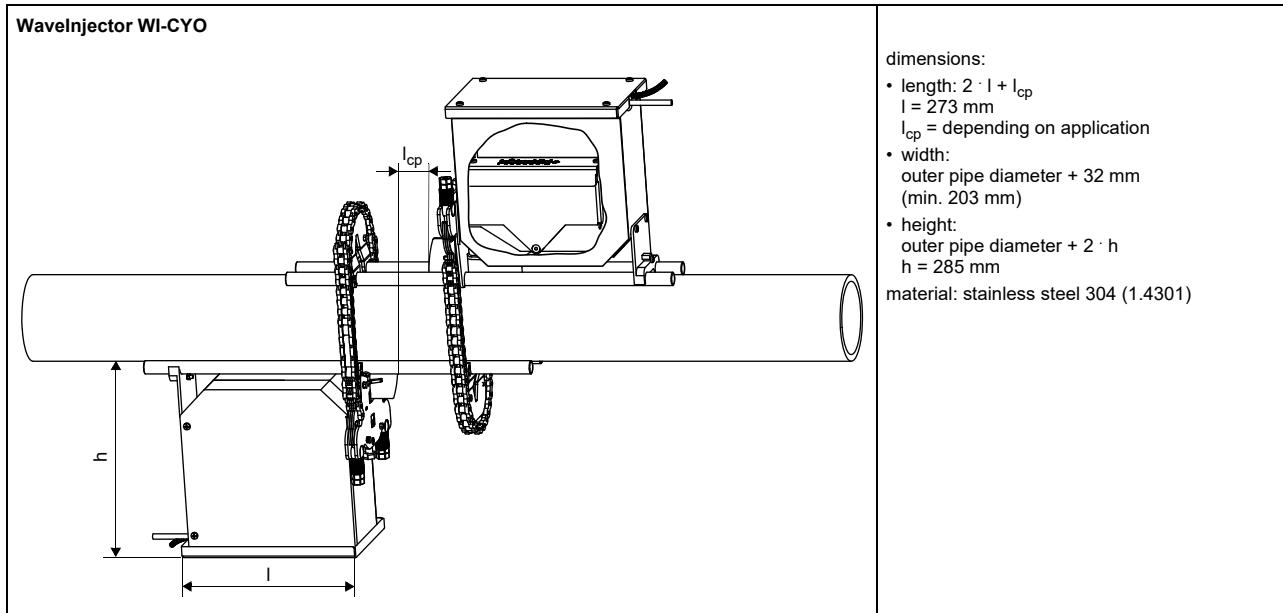

## Coupling materials for transducers

type	ambient temperature °C	position
coupling foil type SI	-40...+80	coupling plate - transducer
coupling foil type D	-200...+80	pipe - coupling plate

## Connection systems

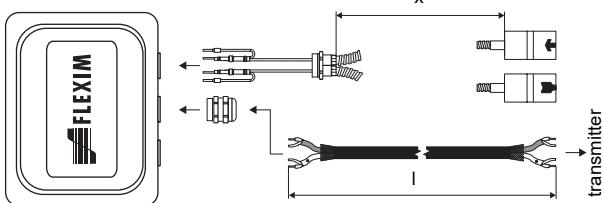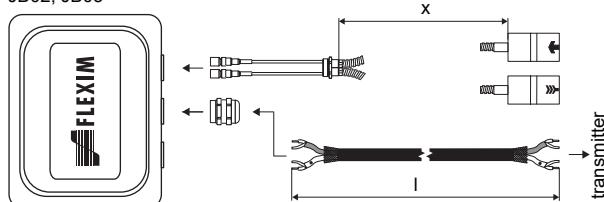connection system TS		transducers technical type
connection with extension cable	direct connection	
JB01	 <p>JB01</p> <p>Diagram illustrating the connection system for JB01. A transducer is connected to a transmitter via a cable. The total length of the cable is labeled 'X'. An intermediate connection point is labeled 'I'.</p>	*****8*
JB02, JB03	 <p>JB02, JB03</p> <p>Diagram illustrating the connection system for JB02 and JB03. A transducer is connected to a transmitter via a cable. The total length of the cable is labeled 'X'. An intermediate connection point is labeled 'I'.</p>	*****52

## Cable

transducer cable		
type	1699	
weight	kg/m	0.094
ambient temperature	°C	-55...+200
properties		
cable jacket		
material		PTFE
outer diameter	mm	2.9
thickness	mm	0.3
colour		brown
shield		x
sheath		
material		stainless steel 304 (1.4301) option OS: 316Ti (1.4571)
outer diameter	mm	8

extension cable		
type	2615	5245
weight	kg/m	0.18      0.38
ambient temperature	°C	-30...+70      -30...+70
properties		halogen free fire propagation test according to IEC 60332-1 combustion test according to IEC 60754-2      halogen free fire propagation test according to IEC 60332-1 combustion test according to IEC 60754-2
cable jacket		
material		PUR
outer diameter	mm	12
thickness	mm	2
colour		black
shield		x
sheath		
material		steel wire braid with copolymer sheath
outer diameter	mm	-      15.6

**Cable length**


transducer frequency		G, K		M, P	
<b>connection system TS</b>					
transducers technical type		x		x	
*D***8*	m	5	≤ 300	4	≤ 300
*D***5*					
option LC: *L***8* *L***5*	m	9	≤ 300	9	≤ 300


x - transducer cable length

| - max. length of extension cable (depending on application)


## Junction box

## Technical data

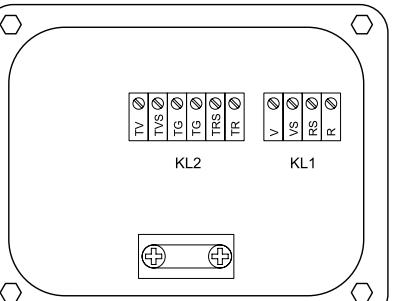
JB01S4E3M			
weight	kg	1.2 kg	
fixation		wall mounting optional: 2" pipe mounting	
material			
housing		stainless steel 316L (1.4404)	
gasket		silicone	
degree of protection		IP67	
ambient temperature			
min.	°C	-40	
max.	°C	+80	
explosion protection			
• ATEX/IECEx			
marking		CE 0637 II2G II2D Ex eb mb IIC T6...T4 Gb Ex tb IIIC T100 °C Db Ta -40...+70/80 °C	
certification ATEX		IBExU06ATEX1161	
certification IECEx		IECEx IBE 08.0006	
type of protection		gas: increased safety decoupled network: encapsulation dust: protection by enclosure	
Connection			
			
Transducers			
terminal strip	terminal	connection	transducer
KL1	V	signal	↑
	VS	internal shield	
	RS	internal shield	↗
	R	signal	
Extension cable			
terminal strip	terminal	connection	
KL2	TV	signal	
	TVS	internal shield	
	TRS	internal shield	
	TR	signal	

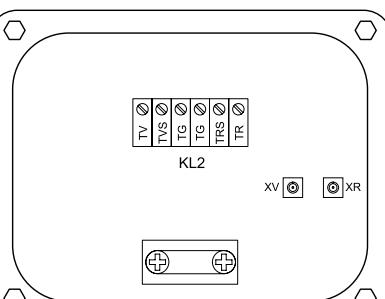JB02, JB03		
weight	kg	1.2 kg
fixation		wall mounting optional: 2" pipe mounting
material		
housing		stainless steel 316L (1.4404)
gasket		silicone
degree of protection		IP67
ambient temperature		
min.	°C	-40
max.	°C	+80
explosion protection		
• ATEX		
junction box		JB02
marking		 II3G Ex nA IIC (T6)...T4 Gc II3D Ex tc IIIC T 100 °C Dc Ta -40...+(70)80 °C
Connection		
		
Transducers		
terminal	connection	transducer
XV	SMB connector	↑
XR	SMB connector	↓
Extension cable		
terminal strip	terminal	connection
KL2	TV	signal
	TVS	internal shield
	TRS	internal shield
	TR	signal

## Dimensions

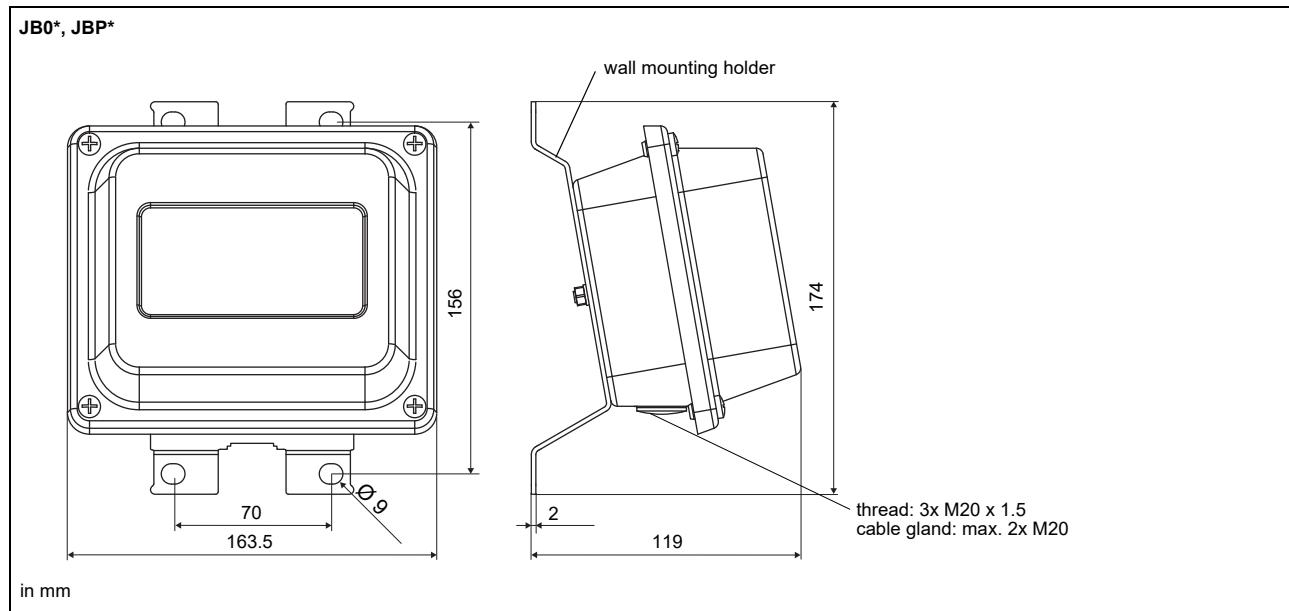

## 2" pipe mounting kit

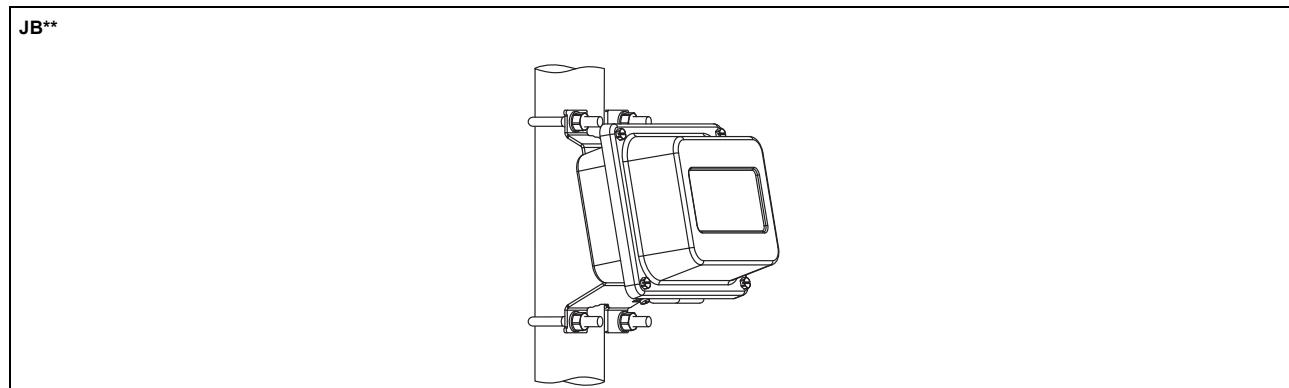

## Transducer heating system (optional)

### Continous operation

fluid temperature < -40 °C: transducer heating system required

### Cycle operation

operating time in cycle operation > 12 h: transducer heating system required

operating time in cycle operation < 12 h and rest period ≥ 2x operating time: see table below

fluid temperature °C	ambient temperature °C	-30	-20	-10	0	+10	+20
-200	x		x	x	x	x	x
-190	x		x	x	x	x	x
-180	x		x	x	x	x	
-170	x		x	x	x	x	
-160	x		x	x	x		
-150	x		x	x	x		
-140	x		x	x	x		
-130	x		x	x			
-120	x		x	x			
-110	x		x				
-100	x		x				
-90	x		x				
-80	x						
-70	x						

x - transducer heating system required

### Technical data

type	BARTEC PSB		
order code	ACC-PE-F***-CY1 (1 measuring channel)	ACC-PE-F***-CY2 (2 measuring channels)	
power supply <sup>1</sup>	208...254 V AC		
consisting of			
heating element	2x PSB 33, 07-5801-2335 power consumption: 2x 44 W	4x PSB 33, 07-5801-2335 power consumption: 4x 44 W	
connection system	2x PLEXO TCS 27-59P1-1010 1x 07-5103-2201/2090	4x PLEXO TCS 27-59P1-1010 1x 07-5103-2201/2090	
junction box PSB			
explosion protection	ATEX, IECEEx, TR TS		

<sup>1</sup> on request: 120 V AC

### Cable junction box PSB - heating element

type	H05SS-F				
length	m	10			
max. length	m	on request			
weight	kg/m	0.11			
ambient temperature	°C	-60...+180			
installation temperature	°C	-20...+50			
bend radius		7.5 D			
cable jacket					
material					
outer diameter	mm	rubber 8...10.4			
colour					
shield	black -				

## Insulation

